

# Safety Instructions

## Proline Prowirl 200

NEPSI: Zone 1, Zone 0/1, Zone 21  
Ex i version



Document: XA01644D  
Safety instructions for electrical apparatus for explosion-  
hazardous areas →  3



# Proline Prowirl 200

## Table of contents

Associated documentation .....	4
Manufacturer's certificates .....	4
Manufacturer address .....	5
Extended order code .....	6
Safety instructions: General .....	9
Safety instructions: Installation .....	10
Safety instructions: Zone 0 .....	12
Safety instructions: Zone 21 .....	12
Temperature tables .....	12
Explosion hazards arising from gas and dust .....	21
Connection data: Signal circuits .....	22

## Associated documentation

All documentation is available:

- On the CD-ROM supplied (not included in the delivery for all device versions).
- Available for all device versions via:
  - Internet: [www.endress.com/deviceviewer](http://www.endress.com/deviceviewer)
  - Smart phone/tablet: *Endress+Hauser Operations App*
- In the Download Area of the Endress+Hauser web site: [www.endress.com](http://www.endress.com) → Download

This document is an integral part of the following Operating Instructions:

Measuring device	Documentation code		
	HART	FOUNDATION Fieldbus	PROFIBUS PA
Prowirl D 200	BA01685D	BA01693D	BA01689D
Prowirl F 200	BA01686D	BA01694D	BA01690D
Prowirl O 200	BA01687D	BA01695D	BA01691D
Prowirl R 200	BA01688D	BA01696D	BA01692D

### Additional documentation

Contents	Document type	Documentation code
Remote display FHX50	Special documentation	SD01007F
	Safety Instructions Zone 0, Zone 21; Ex ia	XA01076F
Overvoltage Protection (OVP)	Special documentation	SD01090F
Explosion Protection	Brochure	CP00021Z/11

Please note the documentation associated with the device.

## Manufacturer's certificates

### NEPSI Declaration of Conformity

Certificate number:

GYJ18.1437X

Affixing the certificate number certifies conformity with the following standards (depending on the device version):

- GB3836.1-2010
- GB3836.4-2010
- GB3836.20-2010
- GB12476.1-2013
- GB12476.4-2010

**Manufacturer  
address**

Endress+Hauser Flowtec AG  
Kägenstrasse 7  
4153 Reinach BL  
Switzerland

## Extended order code

The extended order code is indicated on the nameplate, which is affixed to the device in such a way that it is clearly visible. Additional information about the nameplate is provided in the associated Operating Instructions.

### Structure of the extended order code

*****	_	***** ... *****	+	A*B*C*D*E*F*G*...
<i>(Device type)</i>		<i>(Basic specifications)</i>		<i>(Optional specifications)</i>

\* = Placeholder  
 At this position, an option (number or letter) selected from the specification is displayed instead of the placeholders.

#### *Device type*

The device and the device design is defined in the "Device type" section (Product root).

#### *Basic specifications*

The features that are absolutely essential for the device (mandatory features) are specified in the basic specifications. The number of positions depends on the number of features available. The selected option of a feature can consist of several positions.

#### *Optional specifications*

The optional specifications describe additional features for the device (optional features). The number of positions depends on the number of features available. The features have a 2-digit structure to aid identification (e.g. JA). The first digit (ID) stands for the feature group and consists of a number or a letter (e.g. J = Test, Certificate). The second digit constitutes the value that stands for the feature within the group (e.g. A = 3.1 material (wetted parts), inspection certificate).

More detailed information about the device is provided in the following tables. These tables describe the individual positions and IDs in the extended order code which are relevant to hazardous locations.

### Device type

Position	Order code for	Option selected	Description
1	Instrument family	7	Vortex flowmeter
2	Sensor	D, F, O, R	Sensor type
3	Transmitter	2	Transmitter type: 2-wire, compact version Remote version



Position	Order code for	Option selected	Description
4	Generation index	C	Platform generation
5, 6	Nominal diameter	D: DN 15 to 150 F: DN 15 to 300 O: DN 15 to 300  R: <ul style="list-style-type: none"> <li>■ Reducer DN 25 to 200</li> <li>■ Super reducer DN 40 to 250</li> </ul>	Nominal diameter of sensor

### Basic specifications

Position	Order code for	Option selected	Type of protection
1, 2	Approval	NF	Ex ia IIC T1 ~ T6 Gb
			Ex ia IIC T1 ~ T6 Ga/Gb <sup>1)</sup>
		N4	Ex ia IIC T1 ~ T6 Ga/Gb, Ex iaD 20/21 T*

1) FHX50 is approved according to GYJ13.1123X.

Position	Order code for	Selected option	Description
3	Output; Input	A	4-20mA HART
		B	4-20mA HART, Pulse/frequency/switch output
		C	4-20mA HART + 4-20mA analog
		D	4-20mA HART, Pulse/frequency/switch output, 4-20mA input
		E	FOUNDATION Fieldbus, Pulse/frequency/switch output
		G	PROFIBUS PA, Pulse/frequency/switch output

Position	Order code for	Selected option	Description
4	Display; Operation	A	W/o; via communication
		C	SD02 4-line; push buttons + data backup function
		E	SD03 4-line, illum.; touch control + data backup function
		L	Prepared for display FHX50 + M12 connection <sup>1)</sup>
		M	Prepared for display FHX50 + custom connection <sup>2)</sup>
8, 9	Sensor version; DSC sensor; measuring tube  Only available for sensors F, O, R with the HART communication protocol.	DA	Mass steam; 316L; 316L (integrated pressure/temperature measurement), -200 to +400 °C (-328 to +750 °F)
		DB	Mass gas/liquid; 316L; 316L (integrated pressure/temperature measurement), -40 to +260 °C (-40 to +500 °F)
		DC	Mass steam; Alloy 718; 316L (integrated pressure/temperature measurement), -200 to +400 °C (-328 to +750 °F)
		DD	Mass gas/liquid; Alloy 718; 316L (integrated pressure/temperature measurement), -40 to +100 °C (-40 to +212 °F)
11	Pressure component  Only available for sensors F, O, R with the HART communication protocol.	A	Not used
		B	Pressure measuring cell 2bar/29psi abs
		C	Pressure measuring cell 4bar/58psi abs
		D	Pressure measuring cell 10bar/145psi abs
		E	Pressure measuring cell 40bar/580psi abs
		F	Pressure measuring cell 100bar/1450psi abs



Position	Order code for	Selected option	Description
		G	Pressure measuring cell 160bar/2320psi abs
16, 17	Device Model	A1	1

- 1) FHX50 is approved according to GYJ13.1123X.
- 2) FHX50 is approved according to GYJ13.1123X.

### Optional specifications

ID	Order code for	Option selected	Description
Jx	Test, certificate	JN	Ambient temperature transmitter -50 °C
Nx	Accessory mounted	NA	Overvoltage Protection (OVP)

### Safety instructions: General

- Staff must meet the following conditions for mounting, electrical installation, commissioning and maintenance of the device:
  - Be suitably qualified for their role and the tasks they perform.
  - Be trained in explosion protection.
  - Be familiar with national regulations (e.g. GB/T 3836.15-2017).
- Install the device according to the manufacturer's instructions and the following standards:
  - GB50257-2014 "Code for construction and acceptance of electric device for explosive atmospheres and fire hazard electrical equipment installation engineering"
  - GB3836.13-2013 "Explosive atmospheres - Part 13: Equipment repair, overhaul and reclamation".
  - GB/T3836.15-2017 "Explosive atmospheres – Part 15: Electrical installations design, selection and erection"
  - GB/T3836.16-2017 "Explosive atmospheres – Part 16: Electrical installations inspection and maintenance"
  - GB/T3836.18-2017 "Explosive atmospheres – Part 18: Intrinsically safe electrical systems"
  - GB15577-2007: "Safety regulations for dust explosion prevention and protection". (Only if installed in dust hazardous areas.)
  - GB12476.2-2010 "Electrical apparatus for use in the presence combustible dust – Part 2: Selection and installation". (Only if installed in dust hazardous areas.)
- Do not operate the device outside the specified electrical, thermal and mechanical parameters.
- Only use the device in media to which the wetted materials have sufficient durability.
- Refer to the temperature tables for the relationship between the permitted ambient temperature for the sensor and/or transmitter, depending on the range of application, and the temperature classes.

- Modifications to the device can affect the explosion protection and must be carried out by staff authorized to perform such work by Endress+Hauser.
- Observe all the technical data of the device (see nameplate).
- When using in hybrid mixtures (gas and dust occurring simultaneously), observe additional measures for explosion protection.

## Safety instructions: Installation

In the event of potentially explosive vapor/air mixtures, only operate the device under atmospheric conditions.

- Temperature: -20 to +60 °C
- Pressure: 80 to 110 kPa (0.8 to 1.1 bar)
- Air with normal oxygen content, usually 21 % (V/V)

If no potentially explosive mixtures are present, or if additional protective measures have been taken, the device may also be operated under non-atmospheric conditions in accordance with the manufacturer's specifications.

- Continuous service temperature of the connecting cable: -40 to +80 °C (-50 to +80 °C for optional specifications, ID Jx (Test Certificate) = JN); in accordance with the range of service temperature taking into account additional influences of the process conditions ( $T_{a,min}$  and  $T_{a,max} + 20$  K).
- Only use certified cable entries suitable for the application. Observe selection criteria as per GB/T3836.15-2017.
- When the measuring device is connected, attention must be paid to explosion protection at the transmitter.
- The user shall not change the configuration in order to maintain/ensure the protection performance of this product. Any change may impair safety.

*Basic specification, position 8, 9 (sensor version; DSC sensor; measuring tube) = DA, DB, DC, DD and position 11 (pressure component) = B, C, D, E, F, G*

- The maximum medium temperature is limited for device versions with a pressure component that is installed directly on the sensor F, O, R:
  - To 40 °C for T6 and T5
  - To 90 °C for T4 and T1
- In the case of T4 ... T1 and medium temperatures > 90 °C the pressure component DPC21 must be installed using a spacer tube between the pressure component and the sensor F, O, R.
  - The spacer tube must have a minimum length of 50 cm (1.97 in).
  - The spacer tube supplied meets this requirement.

## Intrinsic safety

- Observe the guidelines for interconnecting intrinsically safe circuits (e.g. GB/T 3836.15-2017 , Proof of Intrinsic Safety).
- The intrinsically safe input power circuit of the device is isolated from ground. If the device is only equipped with one input, the dielectric strength of the input is at least  $500 V_{\text{rms}}$ . If the device is equipped with more than one input, the dielectric strength of each individual input to ground is at least  $500 V_{\text{rms}}$ , and the dielectric strength of the inputs vis-à-vis one another is also at least  $500 V_{\text{rms}}$ .
- The device can be connected to the Endress+Hauser FXA291 service tool: refer to the Operating Instructions.
- The device can be connected to the remote display FHX50 with Ex ia explosion protection; refer to the Special Documentation and Ex documentation.

*Basic specification, position 3 (Output; input) = A, B, C, D, E, G:*

- When the intrinsically safe Ex ia circuits of the device are connected to certified intrinsically safe circuits of Category Ex ib for Equipment Groups IIC or IIB, the type of protection changes to Ex ib IIC or Ex ib IIB.
- When the intrinsically safe Ex ic circuits of the device are connected to certified intrinsically safe circuits of Category Ex ic for Equipment Groups IIB, the type of protection changes from Ex ic IIC to Ex ic IIB.

## Potential equalization

- Integrate the device into the local potential equalization .
- If the ground connection has been established via the pipe as specified, it is also possible to integrate the sensor into the potential equalization system via the pipe.

## Overvoltage protection

Optional specification, ID Nx (Accessory Mounted) = NA

- Minimum ambient temperature when using Overvoltage Protection (OVP):  $-40\text{ }^{\circ}\text{C}$
- When using the internal overvoltage protection: Reduce the admissible ambient temperature at the housing by 2 K.
- For installations which require overvoltage protection to comply with national regulations or standards, install the device using overvoltage protection (e.g. HAW56x from Endress+Hauser).


- Observe the safety instructions of the overvoltage protection.
- If an overvoltage protection against atmospheric over voltages is required: no other circuits may leave the housing during normal operation without additional measures.
- The intrinsically safe input power circuit of the device is isolated from ground. If the device is only equipped with one input, the dielectric strength of the input is at least  $290 V_{\text{rms}}$ . If the device is equipped with more than one input, the dielectric strength of each individual input to ground is at least  $290 V_{\text{rms}}$ , and the dielectric strength of the inputs vis-à-vis one another is also at least  $290 V_{\text{rms}}$ .

**Safety instructions:**  
**Zone 0**

*Basic specification, position 1, 2 (Approval) = N4*

The intrinsically safe version of the device can be used in the measuring pipe in Zone 0.

**Safety instructions:**  
**Zone 21**

- To ensure dust-tightness, securely seal the transmitter housing, cable entries and sealing plugs.
- Only open the transmitter housing briefly, ensuring that no dust or moisture enters the housing.
- Seal unused entry glands with approved sealing plugs that correspond to the type of protection. The plastic transport sealing plug does not meet this requirement and must therefore be replaced during installation.
- Only use certified cable entries and sealing plugs. The metal cable entries, extensions and sealing plugs supplied meet this requirement.
- If the transmitter is connected to the remote display FHX50, the circuit has type of protection Ex iaD 21.  
Connection values →  22


**Temperature tables**

**Ambient temperature**

*Minimum ambient temperature*

*Basic specification, position 3 (Output; Input) = A, B, D in conjunction with optional specification, ID Jx (Test, Certificate) = JN*

$T_a = -50\text{ °C}$

(Not permitted in conjunction with *optional specification, ID Nx (Accessory Mounted) = NA* →  11)

*Basic specification, position 3 (Output; input) = A, B, C, D, E, G:*

$T_a = -40\text{ °C}$

Maximum ambient temperature:

- Compact version  
 $T_a = +70\text{ °C}$  depending on the medium temperature and temperature class
- Transmitter remote version  
 $T_a = +75\text{ °C}$  depending on the medium temperature and temperature class
- Sensor remote version  
 $T_a = +85\text{ °C}$  depending on the medium temperature and temperature class

### Medium temperature

The following relationship of ambient temperature to medium temperature applies when  $T_m < -50\text{ °C}$ :

$T_m\text{ [°C]}$	-50	-100	-150	-200
$T_a\text{ [°C]}$	-50	-47	-44	-39

### Compact version

Basic specification, position 3 (output; input) = A

#### NOTICE

**The ambient temperature changes for installations with overvoltage protection in conjunction with temperature classes T5 and T6.**

The following applies for the basic specification, position 1, 2 (approval) = NF, N4:

- ▶  $T_a = T_a - 2\text{ K}$

Version with max. $T_m = 280\text{ °C}$						
$T_a\text{ [°C]}$	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80 <sup>1)</sup>	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>1)</sup>	-
60	-	95 <sup>2)1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>1)</sup>	-
65	-	-	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>1)</sup>	-
70	-	-	130 <sup>1)</sup>	-	-	-

- 1) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to 40 °C for T6 ...T5 and to 90 °C for T4 ... T1. In the case of T4 ... T1 and medium temperatures > 90 °C, the pressure component DPC21 must be installed using a spacer tube between the pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).
- 2)  $T_a = 55\text{ °C}$  for device versions with pressure component option DA, DB, DC, DD.

Basic specification, position 3 (output; input) = B

### NOTICE

The ambient temperature changes for installations with overvoltage protection in conjunction with temperature classes T5 and T6.

The following applies for the basic specification, position 1, 2 (approval) = NF, N4:

►  $T_a = T_m - 2 \text{ K}$

Version with max. $T_m = 280 \text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
35 <sup>1)</sup>	80 <sup>2)</sup>	95 <sup>2)</sup>	130 <sup>2)</sup>	195 <sup>2)</sup>	280 <sup>2)</sup>	–
50 <sup>3)</sup>	–	95 <sup>2)</sup>	130 <sup>2)</sup>	195 <sup>2)</sup>	280 <sup>2)</sup>	–
60	–	–	130 <sup>2)</sup>	195 <sup>2)</sup>	280 <sup>2)</sup>	–
65	–	–	130 <sup>2)</sup>	195 <sup>2)</sup>	280 <sup>4) 2)</sup>	–
70	–	–	130 <sup>2)</sup>	195 <sup>5) 2)</sup>	280 <sup>5)</sup>	–

- 1)  $T_a = 40 \text{ °C}$  for pulse/frequency/switch output  $P_1 = 0.85 \text{ W}$
- 2) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to  $40 \text{ °C}$  for T6 ...T5 and to  $90 \text{ °C}$  for T4 ... T1. In the case of T4 ... T1 and medium temperatures  $> 90 \text{ °C}$ , the pressure component DPC21 must be installed using a spacer tube between the pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).
- 3)  $T_a = 55 \text{ °C}$  for pulse/frequency/switch output  $P_1 = 0.85 \text{ W}$
- 4)  $T_a = 65 \text{ °C}$  for pulse/frequency/switch output  $P_1 = 0.7 \text{ W}$
- 5)  $T_a = 70 \text{ °C}$  for pulse/frequency/switch output  $P_1 = 0.7 \text{ W}$

Basic specification, position 3 (output; input) = C

### NOTICE

The ambient temperature changes for installations with overvoltage protection in conjunction with temperature classes T5 and T6.

The following applies for the basic specification, position 1, 2 (approval) = NF, N4:

►  $T_a = T_m - 2 \text{ K}$

Version with max. $T_m = 280 \text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80 <sup>1)</sup>	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>1)</sup>	–
55	–	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>1)</sup>	–

Version with max. $T_m = 280\text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
60	-	-	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>1)</sup>	-
65	-	-	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>2) 1)</sup>	-
70	-	-	130 <sup>1)</sup>	-	-	-

- 1) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to 40 °C for T6 ...T5 and to 90 °C for T4 ... T1. In the case of T4 ... T1 and medium temperatures > 90 °C, the pressure component DPC21 must be installed using a spacer tube between the pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).
- 2)  $T_a = 65\text{ °C}$  for pulse/frequency/switch output  $P_1 = 0\text{ W}$

Basic specification, position 3 (output; input) = D

#### NOTICE

#### The ambient temperature changes for installations with overvoltage protection in conjunction with temperature classes T5 and T6.

The following applies for the basic specification, position 1, 2 (approval) = NF, N4:

- $T_a = T_a - 2\text{ K}$

Version with max. $T_m = 280\text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
35	80 <sup>1)</sup>	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>1)</sup>	-
50	-	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>1)</sup>	-
55	-	-	-	195 <sup>1)</sup>	280 <sup>1)</sup>	-
60	-	-	-	195 <sup>1)</sup>	-	-

- 1) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to 40 °C for T6 ...T5 and to 90 °C for T4 ... T1. In the case of T4 ... T1 and medium temperatures > 90 °C, the pressure component DPC21 must be installed using a spacer tube between the pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).

Basic specification, position 3 (output; input) = E, G

**NOTICE****The ambient temperature changes for installations with overvoltage protection in conjunction with temperature classes T5 and T6.**

The following applies for the basic specification, position 1, 2 (approval) = NF, N4:

►  $T_a = T_m - 2 \text{ K}$

Version with max. $T_m = 280 \text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80 <sup>1)</sup>	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>1)</sup>	–
50	–	95 <sup>1)</sup>	130 <sup>1)2)</sup>	195 <sup>1)2)</sup>	280 <sup>1)2)</sup>	–
60	–	–	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>1)</sup>	–
65	–	–	130 <sup>1)</sup>	195 <sup>1)</sup>	280 <sup>3)1)</sup>	–
70	–	–	130 <sup>1)</sup>	195 <sup>4)1)</sup>	280 <sup>4)1)</sup>	–

- 1) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to 40 °C for T6 ...T5 and to 90 °C for T4 ... T1. In the case of T4 ... T1 and medium temperatures > 90 °C, the pressure component DPC21 must be installed using a spacer tube between the pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).
- 2)  $T_a = 60 \text{ °C}$  for pulse/frequency/switch output  $P_i = 0 \text{ W}$
- 3)  $T_a = 65 \text{ °C}$  for pulse/frequency/switch output  $P_i = 0 \text{ W}$
- 4)  $T_a = 70 \text{ °C}$  for pulse/frequency/switch output  $P_i = 0 \text{ W}$

**High-temperature version**

*Basic specification, position 3 (output; input) = A*

**NOTICE****The ambient temperature changes for installations with overvoltage protection in conjunction with temperature classes T5 and T6.**

The following applies for the basic specification, position 1, 2 (approval) = NF, N4:

►  $T_a = T_m - 2 \text{ K}$



Version with max. $T_m = 440\text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80 <sup>1)</sup>	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>
60	–	95 <sup>2)1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>
70	–	–	130 <sup>1)</sup>	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>

- 1) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to 40 °C for T6 ...T5 and to 90 °C for T4 ... T1. In the case of T4 ... T1 and medium temperatures > 90 °C, the pressure component DPC21 must be installed using a spacer tube between the pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).
- 2)  $T_a = 55\text{ °C}$  for device versions with pressure component option DA, DB, DC, DD.

*Basic specification, position 3 (output; input) = B*

#### NOTICE

#### The ambient temperature changes for installations with overvoltage protection in conjunction with temperature classes T5 and T6.

The following applies for the basic specification, position 1, 2 (approval) = NF, N4:

►  $T_a = T_a - 2\text{ K}$

Version with max. $T_m = 440\text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
35 <sup>1)</sup>	80 <sup>2)</sup>	95 <sup>2)</sup>	130 <sup>2)</sup>	195 <sup>2)</sup>	290 <sup>2)</sup>	440 <sup>2)</sup>
50 <sup>3)</sup>	–	95 <sup>2)</sup>	130 <sup>2)</sup>	195 <sup>2)</sup>	290 <sup>2)</sup>	440 <sup>2)</sup>
65	–	–	130 <sup>2)</sup>	195 <sup>2)</sup>	290 <sup>2)</sup>	440 <sup>2)</sup>
70	–	–	130 <sup>2)</sup>	195 <sup>4)2)</sup>	290 <sup>2)</sup>	440 <sup>4)2)</sup>

- 1)  $T_a = 40\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 2) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to 40 °C for T6 ...T5 and to 90 °C for T4 ... T1. In the case of T4 ... T1 and medium temperatures > 90 °C, the pressure component DPC21 must be installed using a spacer tube between the pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).
- 3)  $T_a = 55\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 4)  $T_a = 70\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$

*Basic specification, position 3 (output; input) = C*

**NOTICE****The ambient temperature changes for installations with overvoltage protection in conjunction with temperature classes T5 and T6.**

The following applies for the basic specification, position 1, 2 (approval) = NF, N4:

- $T_a = T_m - 2 \text{ K}$

Version with max. $T_m = 440 \text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80 <sup>1)</sup>	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>
55	–	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>
65	–	–	130 <sup>1)</sup>	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>
70	–	–	130 <sup>1)</sup>	195 <sup>2) 1)</sup>	290 <sup>2) 1)</sup>	440 <sup>2) 1)</sup>

- 1) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to 40 °C for T6 ...T5 and to 90 °C for T4 ... T1. In the case of T4 ... T1 and medium temperatures > 90 °C, the pressure component DPC2 1 must be installed using a spacer tube between the pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).
- 2)  $T_a = 70 \text{ °C}$  for pulse/frequency/switch output  $P_1 = 0 \text{ W}$

*Basic specification, position 3 (output; input) = D*

**NOTICE****The ambient temperature changes for installations with overvoltage protection in conjunction with temperature classes T5 and T6.**

The following applies for the basic specification, position 1, 2 (approval) = NF, N4:

- $T_a = T_m - 2 \text{ K}$

Version with max. $T_m = 440 \text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
35	80 <sup>1)</sup>	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>
50	–	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>
55	–	–	–	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>
60	–	–	–	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>
65	–	–	–	–	290 <sup>1)</sup>	–

- 1) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to 40 °C for T6 ...T5 and to

90 °C for T4 ... T1. In the case of T4 ... T1 and medium temperatures > 90 °C, the pressure component DPC21 must be installed using a spacer tube between the pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).

Basic specification, position 3 (output; input) = E, G

### NOTICE

#### The ambient temperature changes for installations with overvoltage protection in conjunction with temperature classes T5 and T6.

The following applies for the basic specification, position 1, 2 (approval) = NF, N4:

►  $T_a = T_m - 2 \text{ K}$

Version with max. $T_m = 440 \text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80 <sup>1)</sup>	95 <sup>1)</sup>	130 <sup>1)</sup>	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>
50	–	95 <sup>1)</sup>	130 <sup>1) 2)</sup>	195 <sup>1) 2)</sup>	290 <sup>1) 2)</sup>	440 <sup>1) 2)</sup>
65	–	–	130 <sup>1)</sup>	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>
70	–	–	130 <sup>1)</sup>	195 <sup>3) 1)</sup>	290 <sup>3) 1)</sup>	440 <sup>3) 1)</sup>

- 1) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to 40 °C for T6 ... T5 and to 90 °C for T4 ... T1. In the case of T4 ... T1 and medium temperatures > 90 °C, the pressure component DPC21 must be installed using a spacer tube between the pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).
- 2)  $T_a = 60 \text{ °C}$  for pulse/frequency/switch output  $P_1 = 0 \text{ W}$
- 3)  $T_a = 70 \text{ °C}$  for pulse/frequency/switch output  $P_1 = 0 \text{ W}$

### Remote version

#### Transmitter

Basic specification, position 3 Output; Input	Basic specification, position 1, 2 Approval	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]
A	All	40	60	75
B	All	35 <sup>1)</sup>	50 <sup>2)</sup>	70 <sup>3)</sup>
C	All	40	55	70 <sup>4)</sup>

Basic specification, position 3 Output; Input	Basic specification, position 1, 2 Approval	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]
D	All	35 <sup>5)</sup>	50 <sup>5)</sup>	65
E G	All	40	55	70 <sup>4)</sup>

- 1)  $T_a = 40\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 2)  $T_a = 60\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 3)  $T_a = 75\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 4)  $T_a = 75\text{ °C}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$
- 5) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and basic specification, position 1, 2 (Approval) = NF, N4:  $T_a = T_m - 2\text{ K}$

### Sensor

Version with max. $T_m = 280\text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
55	80 <sup>1)2)</sup>	95 <sup>2)</sup>	130 <sup>2)</sup>	195 <sup>2)</sup>	280 <sup>2)</sup>	–
70	–	95 <sup>2)3)</sup>	130 <sup>2)</sup>	195 <sup>2)</sup>	280 <sup>2)</sup>	–
85	–	–	130 <sup>2)</sup>	195 <sup>2)</sup>	280 <sup>2)</sup>	–

- 1)  $T_a = 40\text{ °C}$  For device versions with pressure component option DA, DB, DC, DD.
- 2) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to 40 °C for T6 ...T5 and to and to 90 °C for T4 ... T1. In the case of T4 ... T1 and medium temperatures > 90 °C, the pressure component DPC21 must be installed using a spacer tube between the pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).
- 3)  $T_a = 55\text{ °C}$  for device versions with pressure component option DA, DB, DC, DD.

### High-temperature version

Version with max. $T_m = 440\text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
55	80 <sup>1)2)</sup>	95 <sup>2)</sup>	130 <sup>2)</sup>	195 <sup>2)</sup>	290 <sup>2)</sup>	440 <sup>2)</sup>
70	–	95 <sup>2)3)</sup>	130 <sup>2)</sup>	195 <sup>2)</sup>	290 <sup>2)</sup>	440 <sup>2)</sup>
85	–	–	130 <sup>2)</sup>	195 <sup>2)</sup>	290 <sup>2)</sup>	440 <sup>2)</sup>

- 1)  $T_a = 40\text{ °C}$  For device versions with pressure component option DA, DB, DC, DD.
- 2) For device versions with a pressure component that is installed directly on the sensor F, O, R, the maximum medium temperature is limited to 40 °C for T6 ...T5 and to and to 90 °C for T4 ... T1. In the case of T4 ... T1 and medium temperatures > 90 °C, the pressure component DPC21 must be installed using a spacer tube between the

pressure component and the sensor F, O, R. The length of the spacer tube must be at least 50 cm (1.97 in).

- 3)  $T_a = 55\text{ }^\circ\text{C}$  for device versions with pressure component option DA, DB, DC, DD.

### Explosion hazards arising from gas and dust

#### Determining the temperature class and surface temperature with the temperature table

- In the case of gas: Determine the temperature class as a function of the maximum ambient temperature  $T_a$  and the maximum medium temperature  $T_m$ .
- In the case of dust: Determine the maximum surface temperature as a function of the maximum ambient temperature  $T_a$  and the maximum medium temperature  $T_m$ .

#### Example

- Measured maximum ambient temperature:  $T_{ma} = 58\text{ }^\circ\text{C}$
- Measured maximum medium temperature:  $T_{mm} = 108\text{ }^\circ\text{C}$

$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80	95	130	195	280	-
60	-	95	130	195	280	-
65	-	-	130	195	280	-

A0031266

#### 1 Procedure for determining the temperature class and surface temperature

1. In the column for the maximum ambient temperature  $T_a$  select the temperature that is immediately greater than or equal to the maximum ambient temperature  $T_{ma}$  that is present.

↳  $T_a = 65\text{ }^\circ\text{C}$ .  
The row showing the maximum medium temperature is determined.

2. Select the maximum medium temperature  $T_m$  of this row, which is immediately greater than or equal to the maximum medium temperature  $T_{mm}$  that is present.

↳ The column with the temperature class for gas is determined:  
 $108\text{ }^\circ\text{C} \leq 130\text{ }^\circ\text{C} \rightarrow T4$ .

3. The maximum temperature of the temperature class determined corresponds to the maximum surface temperature for dust:  $T4 = 135\text{ }^\circ\text{C}$ .

**Connection data:  
Signal circuits**

The following tables contain specifications which are dependent on the transmitter type and its input and output assignment. Compare the following specifications with those on the nameplate of the transmitter.

**Cable specification: Connecting cable for remote version**

The sensor cable connection between the sensor and the transmitter has Ex ia type of protection.

Cable parameter:  $L/R \leq 38.2 \mu\text{H}/\Omega$

The cable supplied by Endress+Hauser complies with this value.


**Cable specification for pressure measuring cell connecting cable**

The cable connection between the transmitter and pressure component or between the sensor and pressure component has type of protection Ex ia IIC.

Cable parameter:  $L/R \leq 38.2 \mu\text{H}/\Omega$

The cable supplied by Endress+Hauser complies with the specifications.

**Connecting the transmitter**

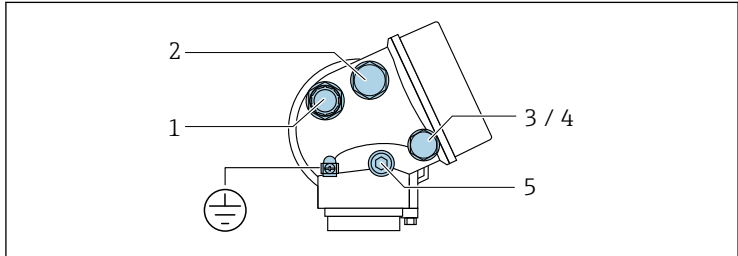

A0034702

Position		Basic specification, position 1, 2: Approval	Type of protection used for cable entry	Description
1	Cable entry for output 1	NF N4	Ex ia Ex ia/Ex iaD	The following applies for devices with basic specification, position 1, 2 (Approval) = N4: In the case of device versions with a plastic transport sealing plug, this plug does not meet the explosion protection requirements and must be replaced during installation by a suitable entry that meets the approval specifications. In the case of device versions with a cable entry, this entry has a separate component approval and meets the requirements of the explosion protection indicated on the nameplate.
2	Cable entry for output 2	NF N4	Ex ia Ex ia/Ex iaD	The following applies for devices with basic specification, position 1, 2 (Approval) = N4: In the case of device versions with metal extensions and sealing plugs, the latter are part of the device approval and meet the requirements of the explosion protection indicated on the nameplate. In the case of device versions with a cable entry, this entry has a separate component approval and meets the requirements of the explosion protection indicated on the nameplate.
3	Optional order code for <sup>1)</sup> : Cable entry of the remote display and operating module FHX50	NF N4	Ex ia Ex ia/Ex iaD <sup>2)</sup>	The following applies for devices with basic specification, position 1, 2 (Approval) = N4: In the case of device versions with metal extensions and sealing plugs, the latter are part of the device approval and meet the requirements of the explosion protection indicated on the nameplate. In the case of device versions with a cable entry, this entry has a separate component approval and meets the requirements of the explosion protection indicated on the nameplate.
4	Optional order code for <sup>3)</sup> : Pressure measuring cell cable entry	NF	Ex ia	–

Position		Description
5	Pressure compensation plug	<p><b>NOTICE</b></p> <p><b>Housing degree of protection voided due to insufficient sealing of the housing.</b></p> <p>▶ Do not open - not a cable entry.</p>
⊕	Potential equalization	<p><b>NOTICE</b></p> <p><b>Terminal for connection to potential equalization.</b></p> <p>▶ Pay attention to the grounding concept of the facility.</p>

- 1) Basic specification, position 4 (display; operation) = L, M
- 2) The labeling changes according to whether "Display; Operation" = "L" or "M": Ex iaD [iaD 20] 20/21 T\*..
- 3) Basic specification, position 8, 9 (sensor version; DSC sensor; measuring tube) = DA, DA, DC, DD and position 11 (pressure component) = B, C, D, E, F, G



## Terminal assignment

### Transmitter



The order code is part of the extended order code. Detailed information on the features of the device and on the structure of the extended order code → 6.

### Connection versions

Order code for "Output"	Terminal numbers					
	Output 1		Output 2		Input	
	1 (+)	2 (-)	3 (+)	4 (-)	5 (+)	6 (-)
Option <b>A</b>	4-20mA HART (passive)		-		-	
Option <b>B</b> <sup>1)</sup>	4-20mA HART (passive)		Pulse/frequency/switch output (passive)		-	
Option <b>C</b> <sup>1)</sup>	4-20mA HART (passive)		4-20mA analog (passive)		-	
Option <b>D</b> <sup>1) 2)</sup>	4-20mA HART (passive)		Pulse/frequency/switch output (passive)		4-20mA current input (passive)	
Option <b>E</b> <sup>1) 3)</sup>	FOUNDATION Fieldbus		Pulse/frequency/switch output (passive)		-	
Option <b>G</b> <sup>1) 4)</sup>	PROFIBUS PA		Pulse/frequency/switch output (passive)		-	

- 1) Output 1 must always be used; output 2 is optional.
- 2) The integrated overvoltage protection is not used with option D: Terminals 5 and 6 (current input) are not protected against overvoltage.
- 3) FOUNDATION Fieldbus with integrated reverse polarity protection.
- 4) PROFIBUS PA with integrated reverse polarity protection.

### Intrinsically safe values



The order code is part of the extended order code. Detailed information on the features of the device and on the structure of the extended order code → 6.

*Type of protection Ex ia*

Order code for "Output"	Output type	Intrinsically safe values	
Option A	4-20mA HART	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 5\ nF$	
Option B	4-20mA HART	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 5\ nF$	
	Pulse/frequency/switch output	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 6\ nF$	
Option C	4-20mA HART	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 30\ nF$	
	4-20mA analog		
Option D	4-20mA HART	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 5\ nF$	
	Pulse/frequency/switch output	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 6\ nF$	
	4 to 20 mA current input	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 5\ nF$	
Option E	FOUNDATION Fieldbus	STANDARD $U_i = 30\ V$ $I_i = 300\ mA$ $P_i = 1.2\ W$ $L_i = 10\ \mu H$ $C_i = 5\ nF$	FISCO $U_i = 17.5\ V$ $I_i = 550\ mA$ $P_i = 5.5\ W$ $L_i = 10\ \mu H$ $C_i = 5\ nF$
	Pulse/frequency/switch output	$U_i = 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 6\ nF$	

Order code for "Output"	Output type	Intrinsically safe values	
Option G	PROFIBUS PA	STANDARD $U_i = 30\text{ V}$ $I_i = 300\text{ mA}$ $P_i = 1.2\text{ W}$ $L_i = 10\text{ }\mu\text{H}$ $C_i = 5\text{ nF}$	FISCO $U_i = 17.5\text{ V}$ $I_i = 550\text{ mA}$ $P_i = 5.5\text{ W}$ $L_i = 10\text{ }\mu\text{H}$ $C_i = 5\text{ nF}$
	Pulse/frequency/switch output	$U_i = 30\text{ V}$ $I_i = 300\text{ mA}$ $P_i = 1\text{ W}$ $L_i = 0\text{ }\mu\text{H}$ $C_i = 6\text{ nF}$	

### Safety-related values



The order code is part of the extended order code. Detailed information on the features of the device and on the structure of the extended order code → 6.

### Remote display FHX50

Basic specification, position 1, 2 Approval	Cable specification	Basic specification, position 4 Display; operation Option L, M
Option NF, N4	Max. cable length: 60 m (196.85 ft)	$U_o = 7.3\text{ V}$
		$I_o = 327\text{ mA}$
		$P_o = 362\text{ mW}$
		$L_o = 149\text{ }\mu\text{H}$
		$C_o = 388\text{ nF}$
		$C_c \leq 125\text{ nF}$
		$L_c \leq 149\text{ }\mu\text{H}$

[www.addresses.endress.com](http://www.addresses.endress.com)

---