

# Safety Instructions

## Deltabar PMD75B, PMD78B

ATEX: II 1/2 D Ex ta/tb IIIC Txxx°C Da/Db  
II 2 D Ex tb IIIC Txxx°C Db  
IECEX: Ex ta/tb IIIC Txxx°C Da/Db  
Ex tb IIIC Txxx°C Db



Document: XA01876P-A  
Safety instructions for electrical apparatus for explosion-  
hazardous areas →  3



# Deltabar PMD75B, PMD78B

## Table of contents

About this document .....	4
Associated documentation .....	4
Supplementary documentation .....	4
Manufacturer's certificates .....	4
Manufacturer address .....	5
Other standards .....	5
Extended order code .....	5
Safety instructions: General .....	7
Safety instructions: Special conditions .....	7
Safety instructions: Installation .....	8
Temperature tables .....	9
Connection data .....	10

## About this document



This document has been translated into several languages. Legally determined is solely the English source text.

The document translated into EU languages is available:

- In the download area of the Endress+Hauser website:  
[www.endress.com](http://www.endress.com) -> Downloads -> Manuals and Datasheets -> Type: Ex Safety Instruction (XA) -> Text Search: ...
- In the Device Viewer: [www.endress.com](http://www.endress.com) -> Product tools -> Access device specific information -> Check device features

## Associated documentation

This document is an integral part of the following Operating Instructions:

PMD75B  
BA02014P/00, TI01511P/00  
PMD78B  
BA02015P/00, TI01512P/00

## Supplementary documentation

Explosion-protection brochure: CP00021Z/11

The Explosion-protection brochure is available:

- In the download area of the Endress+Hauser website:  
[www.endress.com](http://www.endress.com) -> Downloads -> Brochures and Catalogs -> Text Search: CP00021Z
- On the CD for devices with CD-based documentation

## Manufacturer's certificates

### EU Declaration of Conformity

Declaration Number: EC\_00843

The EU Declaration of Conformity is available:

In the download area of the Endress+Hauser website:  
[www.endress.com](http://www.endress.com) -> Downloads -> Declaration -> Type: EU Declaration -> Product Code: ...

### EU type-examination certificate

Certificate number:

KIWA 20ATEX0031 X

List of applied standards: See EU Declaration of Conformity.

### IEC Declaration of Conformity

Certificate number:

IECEX KIWA 20.0011 X

Affixing the certificate number certifies conformity with the following standards (depending on the device version):

- IEC 60079-0 : 2017
- IEC 60079-31 : 2013

**Manufacturer address**

Endress+Hauser SE+Co. KG  
Hauptstraße 1  
79689 Maulburg, Germany  
Address of the manufacturing plant: See nameplate.

**Other standards**

Among other things, the following standards shall be observed in their current version for proper installation:

- IEC/EN 60079-14: "Explosive atmospheres - Part 14: Electrical installations design, selection and erection"
- EN 1127-1: "Explosive atmospheres - Explosion prevention and protection - Part 1: Basic concepts and methodology"

**Extended order code**

The extended order code is indicated on the nameplate, which is affixed to the device in such a way that it is clearly visible. Additional information about the nameplate is provided in the associated Operating Instructions.

**Structure of the extended order code**

PMD7xB	–	*****	+	A*B*C*D*E*F*G*..
<i>(Device type)</i>		<i>(Basic specifications)</i>		<i>(Optional specifications)</i>

\* = Placeholder

At this position, an option (number or letter) selected from the specification is displayed instead of the placeholders.

*Basic specifications*

The features that are absolutely essential for the device (mandatory features) are specified in the basic specifications. The number of positions depends on the number of features available. The selected option of a feature can consist of several positions.

*Optional specifications*

The optional specifications describe additional features for the device (optional features). The number of positions depends on the number of

features available. The features have a 2-digit structure to aid identification (e.g. JA). The first digit (ID) stands for the feature group and consists of a number or a letter (e.g. J = Test, Certificate). The second digit constitutes the value that stands for the feature within the group (e.g. A = 3.1 material (wetted parts), inspection certificate).

More detailed information about the device is provided in the following tables. These tables describe the individual positions and IDs in the extended order code which are relevant to hazardous locations.

### Extended order code: Deltabar

#### *Device type*

PMD75B, PMD78B

#### *Basic specifications*

Position 1, 2 (Approval)		
Selected option		Description
PMD75B	BG	ATEX II 1/2 G Ex ta/tb IIIC Txxx°C Da/Db
PMD78B		ATEX II 2 D Ex tb IIIC Txxx°C Db IECEX Ex ta/tb IIIC Txxx°C Da/Db IECEX Ex tb IIIC Txxx°C Db

Position 6 (Housing, Material)		
Selected option		Description
PMD75B	B	Single compartment; Alu, coated
PMD75B	J	Dual compartment; Alu, coated
PMD78B	K	Dual compartment; 316L
	M	Dual compartment L-shape; Alu, coated

Position 7 (Electrical Connection)		
Selected option		Description
PMD75B	B	Gland M20, brass nickel plated, IP66/68 NEMA Type 4X/6P
PMD78B	C	Gland M20, 316L, IP66/68 NEMA Type 4X/6P
	F	Thread M20, IP66/68 NEMA Type 4X/6P
	G	Thread G1/2, IP66/68 NEMA Type 4X/6P
	H	Thread NPT1/2, IP66/68 NEMA Type 4X/6P

### *Optional specifications*

No options specific to hazardous locations are available.


#### **Safety instructions: General**

- Devices suitable for zone separation (marked Ga/Gb or Da/Db) are always suitable for installation in the less critical zone (Gb or Db). Due to space limitations the corresponding marking maybe not indicated on the nameplate.
- Comply with the installation and safety instructions in the Operating Instructions.
- Staff must meet the following conditions for mounting, electrical installation, commissioning and maintenance of the device:
  - Be suitably qualified for their role and the tasks they perform
  - Be trained in explosion protection
  - Be familiar with national regulations
- Install the device according to the manufacturer's instructions and national regulations.
- Do not operate the device outside the specified electrical, thermal and mechanical parameters.
- Only use the device in media to which the wetted materials have sufficient durability.
- Avoid electrostatic charging:
  - Of plastic surfaces (e.g. housing, sensor element, special varnishing, attached additional plates, ..)
  - Of isolated capacities (e.g. isolated metallic plates)
- Modifications to the device can affect the explosion protection and must be carried out by staff authorized to perform such work by Endress+Hauser.

#### **Safety instructions: Special conditions**

- In the case of process connections made of polymeric material or with polymeric coatings, avoid electrostatic charging of the plastic surfaces.
- For light metal flanges or flange faces (e.g. titanium, zirconium), avoid sparks caused by impact and friction.
- To avoid electrostatic charging: Do not rub surfaces with a dry cloth.
- In the event of additional or alternative special varnishing on the housing or other metal parts or for adhesive plates:
  - Observe the danger of electrostatic charging and discharge.
  - Do not install in the vicinity of processes ( $\leq 0.5$  m) generating strong electrostatic charges.
- Avoid sparks caused by impact and friction.

**Safety instructions:  
Installation**

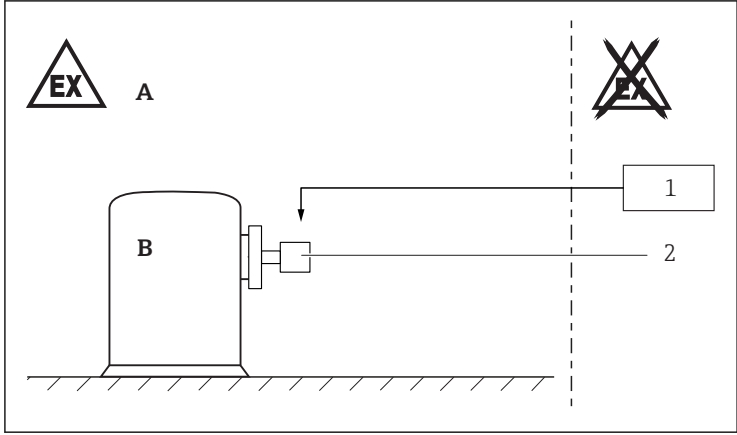

A0041997

- A Zone 21, Electronic
- B Zone 20 or Zone 21, Process
- 1 Power supply
- 2 PMD75B, PMD78B

- After aligning (rotating) the housing, retighten the fixing screw.
- Do not open in a potentially explosive dust atmosphere.
- Seal the cable entry or piping tight (see ingress protection of housing in the "Temperature tables" chapter).
- Before operation:
  - Screw in the cover all the way.
  - Tighten the securing screw on the cover.

*Permitted ambient conditions*


**Ex ta/tb IIIC Txxx°C Da/Db**

Process Zone 20		Housing Zone 21
Continuous dust submersion		Dust accumulation or temporary explosive dust atmosphere
Continuous explosive dust atmosphere and deposits		Dust accumulation or temporary explosive dust atmosphere




**Ex tb IIIC T<sub>xxx</sub>°C Db**


Process Zone 21	Housing Zone 21
Continuous dust deposits or temporary explosive dust atmosphere	Dust accumulation or temporary explosive dust atmosphere



**Temperature  
tables**

-  The specified surface temperature takes into account all direct heat influences from process heat and self-heating at the housing.
- Surface temperatures at the process side maybe higher and must be considered by the user (e.g. at high temperature process connections).
- The T-marking is based on the process temperature of the compact designs.
- The specified ambient and process temperature ranges exclusively refer to the explosion protection and must not be exceeded. Operationally permitted ambient temperature ranges can be restricted depending on the version: See Operating Instructions.
- Do not exceed the max. ambient temperature at the housing.
- The process temperatures refer to the temperature at the separation membrane.

For detailed information see Technical Information.

 *Basic specification, Position 6 (Housing; Material) = K*  
When using the stainless steel housing: Reduce the admissible ambient temperature by 5 K.

 Ingress protection of housing: IP66/67

**Device Type PMD75B**

Ex ta/tb IIIC T<sub>200</sub> 100°C Da/Db

Ex tb IIIC T<sub>L</sub> 100°C Db

Maximum surface temperature	Process temperature range	Ambient temperature range
T100 °C	-40 °C ≤ T <sub>p</sub> ≤ +100 °C	-40 °C ≤ T <sub>a</sub> ≤ +65 °C

Specific conditions of use:

- The surface temperature is
  - for equipment protection level (EPL) Da:  $T_{200}$  100 °C (with 200 mm dust deposit)
  - and equipment protection level (EPL) Db:  $T_L$  100 °C (with dust accumulation  $T_L$ )
- The surface temperature is for equipment protection level (EPL) Db:  $T_L$  100 °C (with dust accumulation  $T_L$ )



$T_L$  marking:

The assigned surface temperature without dust layer is the same.

### Device Type PMD78B

Ex ta/tb IIIC  $T_{200}$  100°C Da/Db

Ex tb IIIC  $T_L$  100°C Db

Maximum surface temperature	Process temperature range	Ambient temperature range
$T_{100}$ °C	$-40\text{ °C} \leq T_p \leq +400\text{ °C}$	$-40\text{ °C} \leq T_a \leq +70\text{ °C}$

Specific conditions of use:

- The surface temperature is
  - for equipment protection level (EPL) Da:  $T_{200}$  100 °C (with 200 mm dust deposit)
  - and equipment protection level (EPL) Db:  $T_L$  100 °C (with dust accumulation  $T_L$ )
- The surface temperature is for equipment protection level (EPL) Db:  $T_L$  100 °C (with dust accumulation  $T_L$ )



$T_L$  marking:

The assigned surface temperature without dust layer is the same.

### Connection data

Power supply
$U \leq 35\text{ V}_{DC}$ $P \leq 1\text{ W}$

## Cable entry: Connection compartment

### Ex tb

Cable gland: *Basic specification, Position 7 (Electrical Connection) = B*

Thread	Clamping range	Material	Sealing insert	O-ring
M20x1,5	ø 8 to 10.5 mm <sup>1)</sup> ø 6.5 to 13 mm <sup>2)</sup>	Ms, nickel-plated	Silicone	EPDM (ø 17x2)

1) Standard

2) Separate clamping inserts available

Cable gland: *Basic specification, Position 7 (Electrical Connection) = C*

Thread	Clamping range	Material	Sealing insert	O-ring
M20x1,5	ø 7 to 12 mm	1.4404	NBR	EPDM (ø 17x2)



- The tightening torque refers to cable glands installed by the manufacturer:
  - Recommended: 3.5 Nm
  - Maximum: 10 Nm
- This value may be different depending on the type of cable. However, the maximum value must not be exceeded.
- Only suitable for fixed installation. The operator must pay attention to a suitable strain relief of the cable.
- The cable glands are suitable for a low risk of mechanical danger (4 Joule) and must be mounted in a protected position if larger impact energy levels are expected.
- To maintain the ingress protection of the housing: Install the housing cover, cable glands and blind plugs correctly.



71492419

[www.addresses.endress.com](http://www.addresses.endress.com)

---