

Safety Instruction

NAR300

Oil Leak Detector


Certification No. 0003049525



Safety Instructions for Electrical Apparatus Certified
for Use in Explosion-hazardous Areas

NOTICE

NAR300 must be combined with NRR261 or NRR262 to meet the requirements of FM standard class 7745.

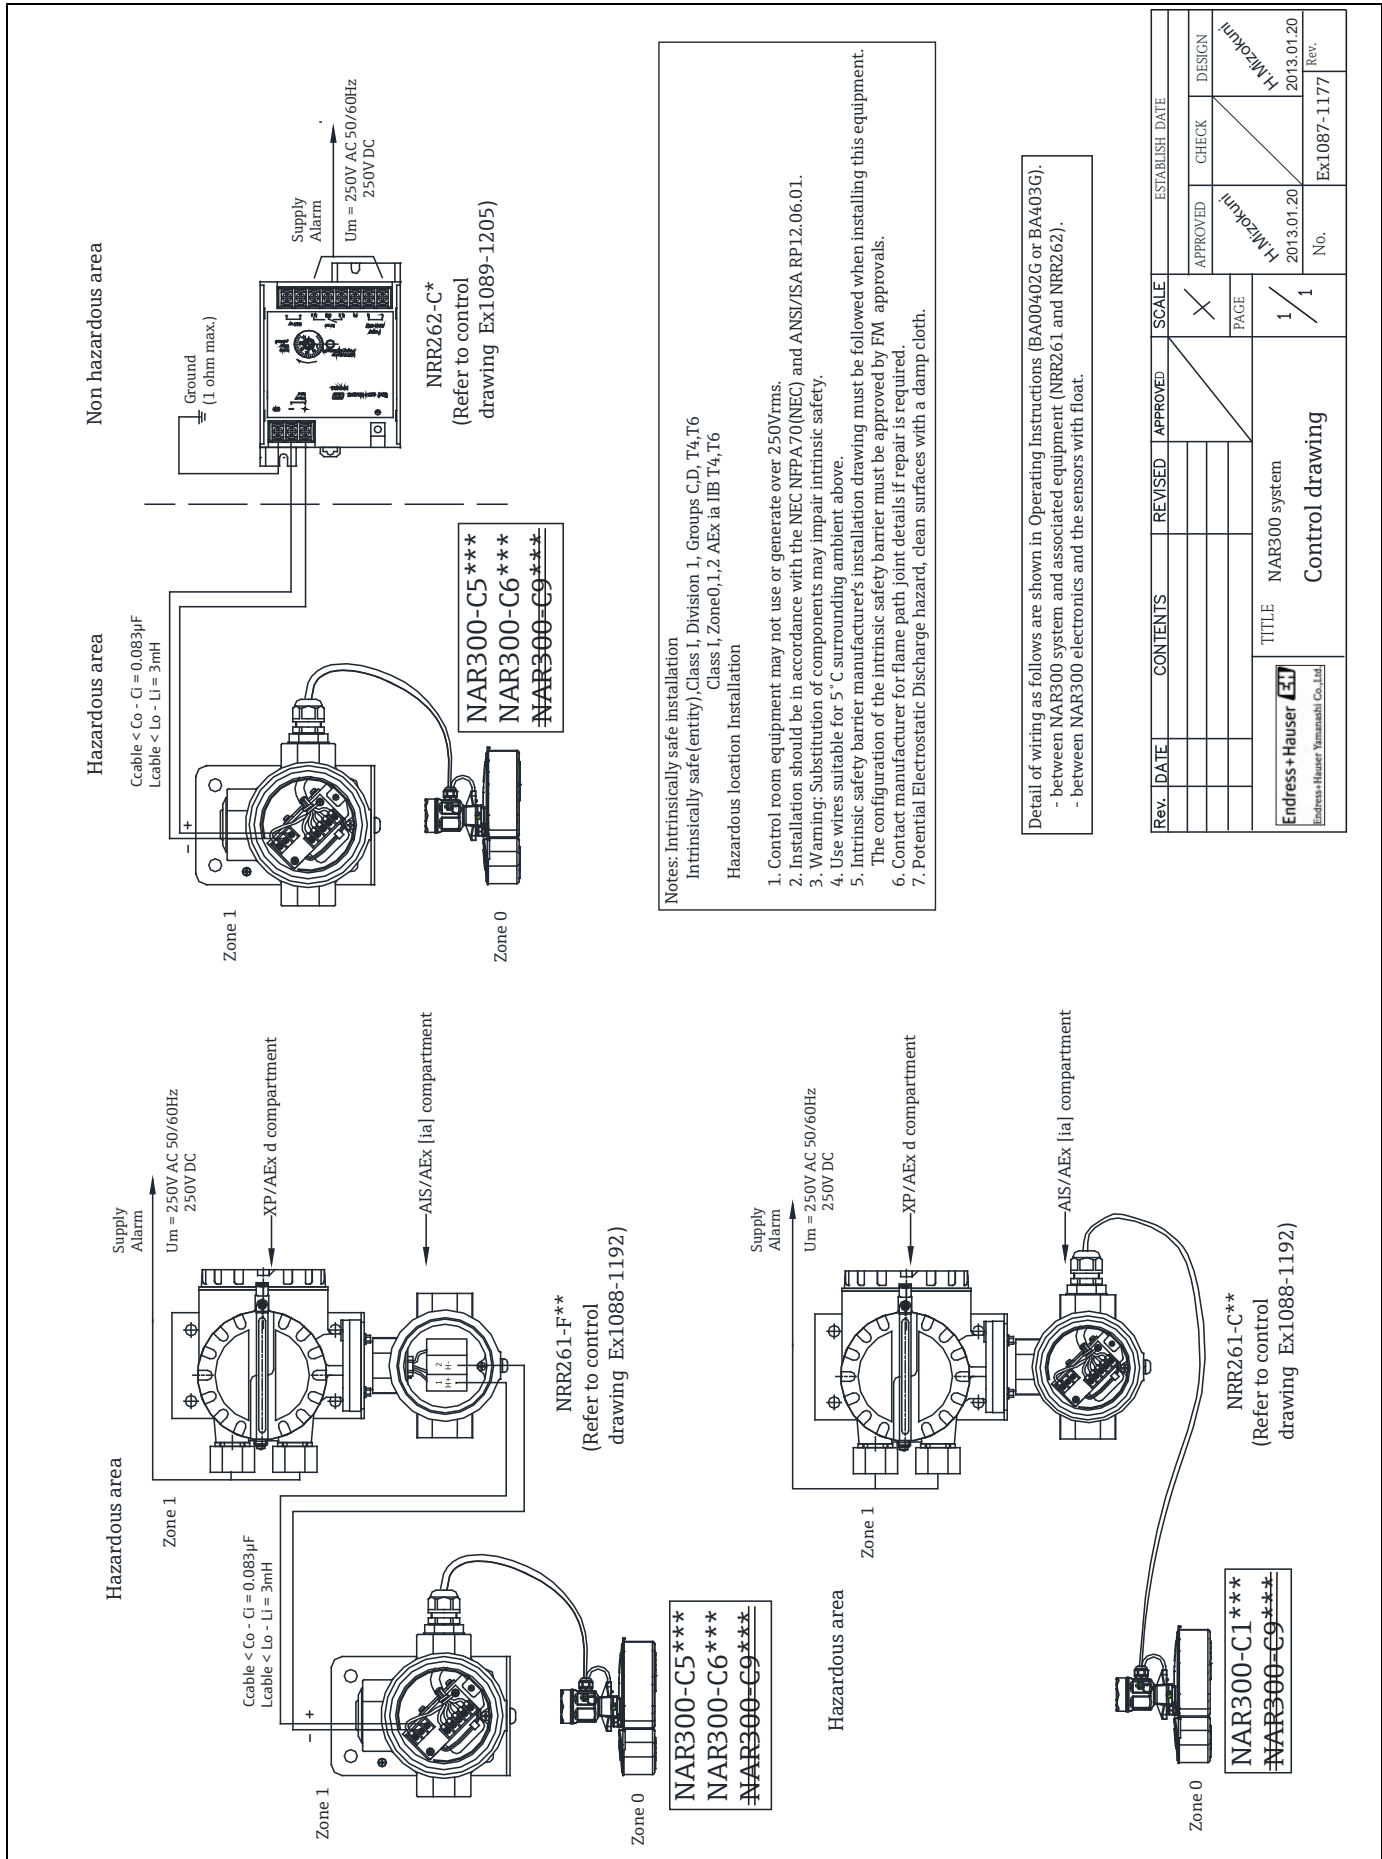

Rev.	DATE	CONTENTS	REVISED	APPROVED	SCALE	ESTABLISH DATE		
					1 / 1	APPROVED	CHECK	DESIGN
		TITLE NAR300 system				H.Mezkani		H.Mezkani
		Control drawing				2013.01.20		2013.01.20
						No.		Ex1087-1177
								Rev.