



71361423


CSA Control Drawing 960014220 B

Cerabar M PMP51, PMP55
 PROFIBUS PA, FOUNDATION Fieldbus

People for Process Automation

HAZARDOUS (CLASSIFIED) LOCATION

Class I, Zone 0, IIC
 Class I, Division 1, 2, Groups A, B, C, D
 Class II, Division 1, 2, Groups E, F, G
 Class III

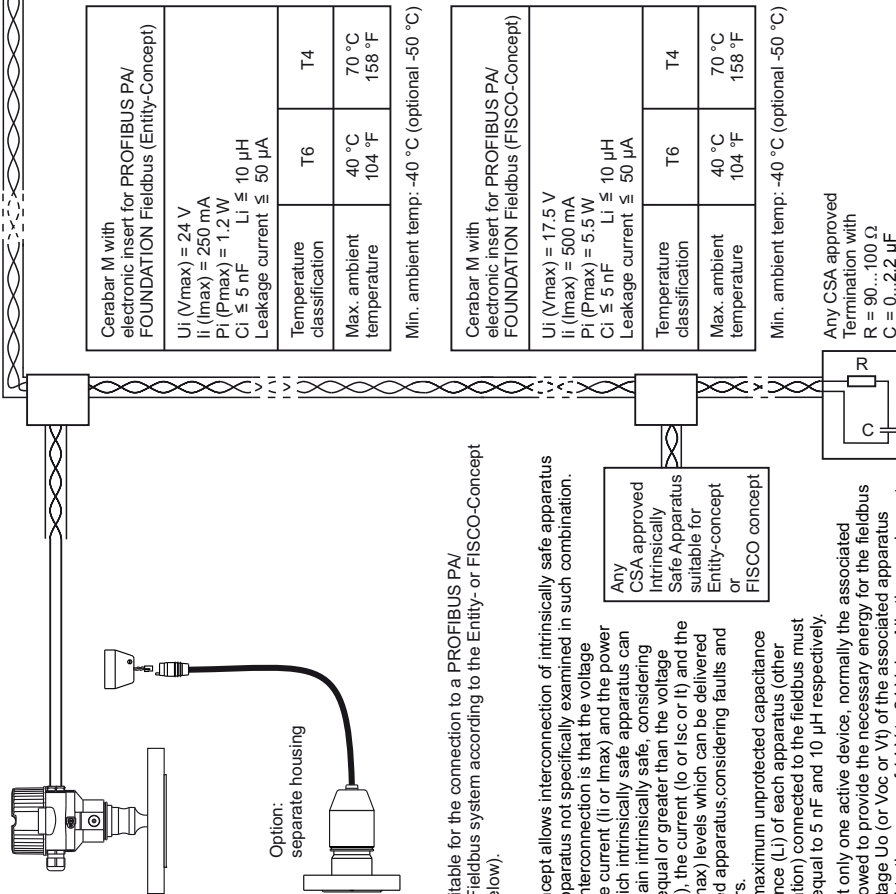

Cerabar M is suitable for the connection to a PROFIBUS PA/ FOUNDATION Fieldbus system according to the Entity- or FISCO-Concept (as described below).

FISCO-Concept

The FISCO-Concept allows interconnection of intrinsically safe apparatus to associated apparatus not specifically examined in such combination. The criteria for interconnection is that the voltage (Ui or Vmax), the current (Ii or Imax) and the power (Pi or Pmax) which intrinsically safe apparatus can receive and remain intrinsically safe, considering faults, must be equal or greater than the voltage (Uo or Voc or Vi), the current (Io or Isc or It) and the power (Po or Pmax) levels which can be delivered by the associated apparatus, considering faults and applicable factors. In addition, the maximum unprotected capacitance (C) and inductance (L) of each apparatus (other than the termination) connected to the fieldbus must be less than or equal to 5 nF and 10 µH respectively.

In each segment only one active device, normally the associated apparatus, is allowed to provide the necessary energy for the fieldbus system. The voltage Uo (or Voc or Vi) of the associated apparatus has to be limited to the range of 14 V to 24 V d.c. All other equipment connected to the bus cable has to be passive, meaning that they are not allowed to provide energy to the system, except to a leakage current of 50 µA for each connected device. Separately powered equipment needs a galvanic isolation to assure that the intrinsically safe fieldbus circuit remains passive.

The cable used to interconnect the devices needs to have the parameters in the following range:

loop resistance R: 15...150 Ohm/km
 inductance per unit length L: 0.4...1 mH/km
 capacitance per unit length C: 80...200 nF/km
 C = C' line/line + 0.5 C' line/screen, if both lines are floating or C' line/line + C' line/screen, if the screen is connected to one line

length of spur cable: 30 m
 length of trunk cable: 1 km
 length of splice: 1 m
 At each end of the trunk cable an approved infallible line termination with the following parameters is suitable:
 R = 90...100 Ohm C = 0...2.2 µF

One of the allowed terminations might already be integrated in the associated apparatus.

NONHAZARDOUS LOCATION

Any CSA Approved Associated Apparatus suitable for Entity-concept or FISCO-concept

INTRINSICALLY SAFE

CLASS I, DIV.1, GROUPS A, B, C, D CLASS II, DIV.1, GROUPS E, F, G CLASS III Ex Ia IIC T6

1. CSA certified apparatus must be installed in accordance with manufacturer instructions.
2. CSA certified associated apparatus must meet the following requirements:
 Uo or Voc or Vi ≤ Ui (Vmax) and Io or Isc or It ≤ Ii (Imax) and Po or Pmax ≤ Pi (Pmax).
3. The maximum non-hazardous area voltage must not exceed 250 V.
4. The installation must be in accordance with the Canadian Electrical Code or National Electrical Code (ANSI/NFPA70) and ISA RP-12.06.01.
5. Be aware of multiple earthing of screen. The screen must be connected in accordance with Canadian Electrical Code or National Electrical Code (ANSI/NFPA70) and ISA RP-12.06.01.
6. Caution: Use only supply wires suitable for 5 °C above surrounding temperature.
7. Warning: Substitution of components may impair intrinsic safety.
8. The polarity for connecting is of no importance due to an internal rectifier.
9. Warning: Avoid electrostatic charging of plastic surfaces, plastic process connections or coatings.

Suitable for: CLASS I, DIV.2, GROUPS A, B, C, D CLASS II, DIV.1, GROUPS E, F, G.

HAZARDOUS LOCATION INSTALLATION

1. Install per Canadian Electrical Code (CEC) or National Electrical Code (ANSI/NFPA70) and ISA RP 12.06.01.
2. WARNING: Explosion Hazard - Do not disconnect equipment unless power has been switched off or the area is known to be Non-Hazardous.
 AVERTISSEMENT : Risque d'explosion - Ne pas débrancher tant que le circuit est sous tension, à moins qu'il s'agisse d'un emplacement non dangereux.
 WARNING: Explosion Hazard - Substitution of components may impair suitability for Class I, DIV.2.
 AVERTISSEMENT : Risque d'explosion - La substitution de composant peut rendre ce matériel inacceptable pour les emplacements de Class I, DIV.2.

The devices are CSA Certified as Single Seal per ANSI/ISA 12.27.01 as tabulated below; therefore installation of external secondary seals is not required.

Single Seal	Model	Limited to:	
		MWP*	Process Temperature**
	PMP51, PMP55	400 bar (5800 psi)	-40 °C...+100 °C
	PMP51	40 bar (600 psi)	-40 °C...+125 °C

* Limitations of the Maximum Working Pressure (MWP) are marked on the nameplate and must be considered

** Limitations of the process temperature range depending on the used version are specified in the applicable technical information of the manufacturer and must be considered! PMP55 allows higher process temperatures depending on the used diaphragm seal. This is allowable provided the above specified process temperatures are guaranteed at the sensor close to the enclosure (location of primary seal) for these types.