

ZD 036F/00/en/01.02/CCS
CSA / B 28.02.01



Control drawing (IS) 960373-2021 B

Deltapilot S
FEB 24 / FEB 24 P
(PROFIBUS-PA)

Endress + Hauser



The Deltapilot S with electronic insert FEB 24 (P) is suitable for the connection to a fieldbus system (e.g. PROFIBUS-PA) according to both the Entity-Concept or the FISCO-Concept (as described below).

FISCO-Concept

The FISCO Concept allows interconnection of intrinsically safe apparatus to associated apparatus not specifically examined in such combination. The criteria for interconnection is that the voltage (U_i or V_{max}), the current (I_i or I_{max}) and the power (P_i or P_{max}) which intrinsically safe apparatus can receive and remain intrinsically safe, considering faults, must be equal or greater than the voltage (U_o or V_o), the current (I_o or I_o) and the power (P_o or P_{max}) levels which can be delivered by the associated apparatus, considering faults and applicable factors. In addition, the maximum unprotected capacitance (C) and inductance (L) of each apparatus (other than the termination) connected to the fieldbus must be less than or equal to 5 nF and 10 µH respectively. Each segment only one active device, normally the associated apparatus, is allowed to provide the necessary energy for the fieldbus system. The voltage U_o (or V_o or V_i) of the associated apparatus has to be limited to the range of 14V to 24V DC. All other equipment connected to the bus cable has to be passive, meaning that they are not allowed to provide energy to the system, except to a leakage current of 50 µA for each connected device. Separately powered equipment needs a galvanic isolation to assure that the intrinsically safe fieldbus circuit remains passive. The cable used to interconnect the devices needs to have the parameters in the following range:

loop resistance R:	15 ... 150 Ω/km
inductance per unit length L:	0.4 ... 1 mH/km
capacitance per unit length C:	80 ... 200 nF/km
C = C' line/line + 0.5 C' line/screen, if both lines are floating or one line	
length of spur cable:	≤ 30 m
length of trunk cable:	≤ 1 km
length of splice:	≤ 1 m

At each end of the trunk cable an approved intallible line termination with the following parameters is suitable:

$$R = 90 \dots 100 \Omega$$

$$C = 0 \dots 2.2 \mu F$$

One of the allowed terminations might already be integrated in the associated apparatus.

Notes:

INTRINSICALLY SAFE CLASS I, DIV. 1, GROUPS A, B, C, D



- CSA certified apparatus must be installed in accordance with manufacturer instructions
- CSA certified associated apparatus must meet the following requirements:
 U_o or V_o or $V_i \leq U_i$ (V_{max}) and I_o or I_o or $I_i \leq I_i$ (I_{max}) and P_o or $P_{max} \leq P_i$ (P_{max})
- The maximum non-hazardous area voltage must not exceed 250 V
- The installation must be in accordance with the Canadian Electrical Code
- Multiple earthing of screen is allowed only, if high integrity equipotential system is realised between the points of bonding (see drawing No. 960373-1022 A).
- Caution: Use only supply wires suitable for 5°C above surrounding temperature
- WARNING: Substitution of components may impair intrinsic safety.
- AVERTISSEMENT: La substitution de composants peut compromettre la sécurité intrinsèque.
- The electronic insert FEB 24 P must be connected to I.S. Ground.
- The polarity for connecting PA+ (2) and PA- (1) is of no importance due to an internal rectifier.

Suitable for CLASS 1, DIV. 2, GROUP A, B, C, D, HAZARDOUS LOCATION INSTALLATION.

- INSTALL PER CANADIAN ELECTRICAL CODE (CEC) USING THREADED METAL CONDUIT. Intrinsic safety barrier not required. Max. supply voltage 30 V. For T-code see table.
- WARNING: Explosion Hazard – do not disconnect equipment unless power has been switched off or the area is known to be Non-Hazardous.
- AVERTISSEMENT: Risque d'explosion – Ne pas débrancher tant que le circuit est sous tension, à moins qu'il s'agisse d'un emplacement non dangereux.
- WARNING: Explosion Hazard – Substitution of components may impair suitability for Class I, Division 2.
- AVERTISSEMENT: Risque d'explosion – La substitution de composants peut rendre ce matériel inacceptable pour les emplacements de Class I, Division 2.

HAZARDOUS (CLASSIFIED) LOCATION


Ex ia IIC T6
Class I, Division 1, Groups A, B, C, D
Class II, Division 1, Groups E, F, G
Class III, Division 1



Any CSA Approved Intrinsically Safe Apparatus suitable for Entity-Concept or FISCO-Concept

Any CSA Approved Termination with
 $R = 90 \dots 100 \Omega$
 $C = 0 \dots 2.2 \mu F$

NONHAZARDOUS LOCATION

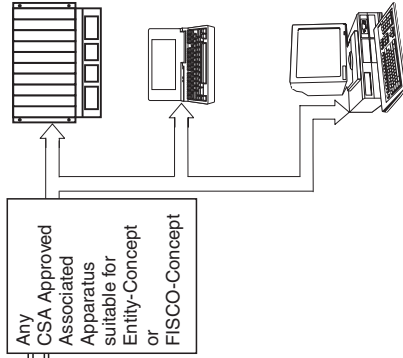

Deltapilot S with electronic insert FEB 24 P	
U_i (V_{max}) = 24 V	(Entity-Concept)
I_i (I_{max}) = 250 mA	
P_i (P_{max}) = 1.2 W	
U_i (V_{max}) = 17.5 V	(FISCO-Concept)
I_i (I_{max}) = 500 mA	
P_i (P_{max}) = 5.5 W	
$C_i \leq 5$ nF, $L_i \leq 10$ µH	
Leakage current ≤ 50 µA	
Temperature classification	T6 T5 T4
Max. ambient temperature	55°C 70°C 80°C
	131°F 158°F 176°F
Max. medium temperature	70°C 85°C 120°C
	158°F 185°F 248°F
Deltapilot S with electronic insert FEB 24	
U_i (V_{max}) = 24 V	(Entity-Concept)
I_i (I_{max}) = 250 mA	
P_i (P_{max}) = 1.2 W	
U_i (V_{max}) = 17.5 V	(FISCO-Concept)
I_i (I_{max}) = 500 mA	
P_i (P_{max}) = 5.5 W	
$C_i \leq 5$ nF, $L_i \leq 10$ µH	
Leakage current ≤ 50 µA	
Temperature classification	T6 T5 T4
Max. ambient temperature	60°C 75°C 80°C
	140°F 167°F 176°F
Max. medium temperature	70°C 85°C 120°C
	158°F 185°F 248°F