


Non Hazardous Location

Hazardous location

Class I, Div. 1, Group A,B,C,D
 Class I, Div. 2, Group A,B,C,D
 Class II, Div. 1, Group E,F,G
 Class II, Div. 2, Group F,G
 Class III

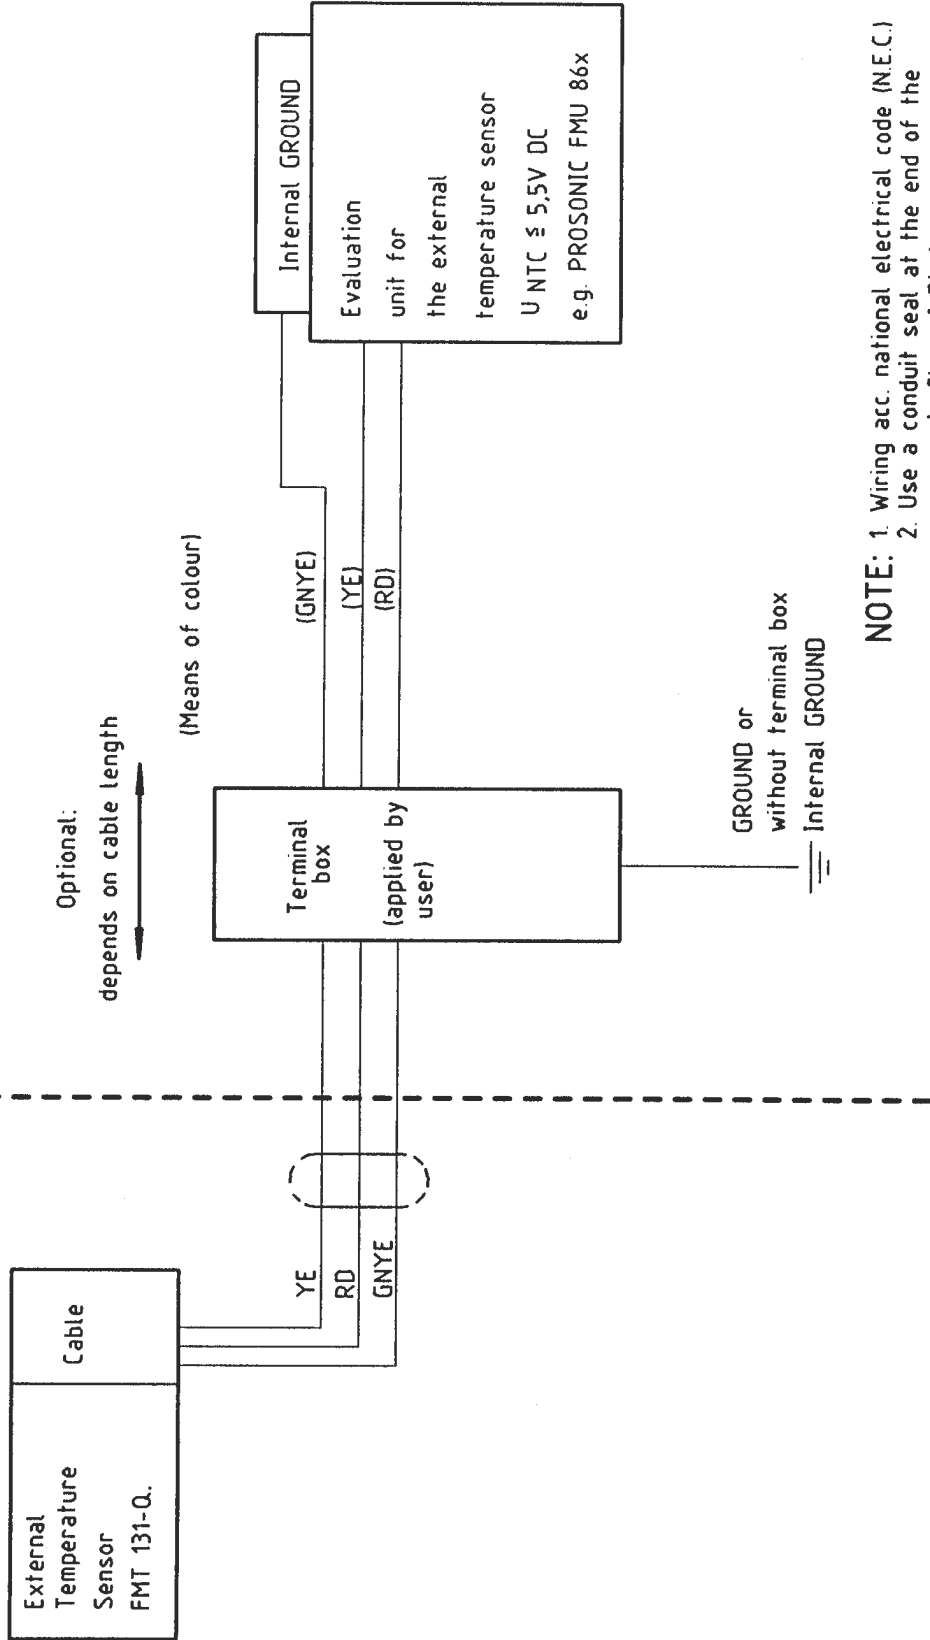

- NOTE:**
1. Wiring acc. national electrical code (N.E.C.)
 2. Use a conduit seal at the end of the sensor in Class I Div.1
 3. For more information see: Installation and operating instruction.
 4. Conduit entry not bonded to ground
 5. No revision without prior FMRC APPROVAL

