

Supplementary documentation

All important Temperature Operating Instructions, particularly with regard to head and field transmitters are available on CD-ROM, find enclosed or order by order number: **SONDTT-AG**.


KA00178R/24/EN/13.12
71207980

Products

Solutions

Services

Compact Instructions RTD Temperature sensor TH11

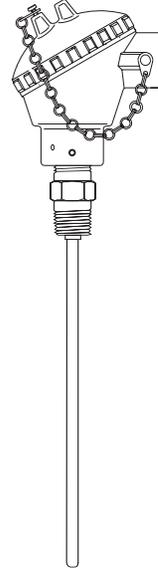

Measuring System

General purpose RTD with connection head TH11 for process and laboratory applications.

The single element RTD is specifically designed for use in two different process temperature ranges (low range RTD -58°F to 392°F ; high range RTD -328°F to 1112°F).

www.addresses.endress.com

Endress+Hauser 
People for Process Automation

Endress+Hauser 
People for Process Automation

Though the information provided herein is believed to be accurate, be advised that the information contained herein is NOT a guarantee of satisfactory results. Specifically, this information is neither a warranty nor guarantee, expressed or implied, regarding performance, merchantability, fitness, or other matter with respect to the products; and recommendation for the use of the product/process information in conflict with any patent. Please note that Endress+Hauser reserves the right to change and/or improve the product design and specifications without notice.

CAUTION Cautions draw attention to activities or procedures that can lead to persons being seriously injured, to safety risks or to the destruction of the device if they are not carried out properly.

Notes draw attention to activities or procedures that can have a direct influence on operation or trigger an unforeseen device reaction if they are not carried out properly.



Safety pictograms and symbols

Returns Please follow the Return Authorization Policy which is attached with this manual.

Installation and operation The unit is constructed using the most up to date production equipment and installed in accordance with the safety requirements of the local guidelines. However, it is important that the safety requirements of the local guidelines are followed. Installation, wiring and maintenance of the unit must only be completed by trained, skilled personnel who are authorized to do so by the plant operator. The plant operator must make sure that the measurement system has been correctly wired to the connection schematics. Procedures indicated in these instructions must be followed.

The accessories for pipe connections and the appropriate gaskets and sealing rings are not supplied with the sensors. These are the customer's responsibility. Depending on temperature and pressure operating conditions, the gaskets, the sealing and the applicable torques must be selected by the user. For further information regarding connections, please refer to the corresponding Standards.

CAUTION Do not disconnect equipment unless power has been switched off or the area is not hazardous.

CAUTION The manufacturer cannot be held responsible for damage caused by misuse of the unit. The installation conditions and connection values indicated in the operating instructions must be followed!

1. Install the unit according to the relevant NEC Code and local regulations.
2. Avoid any spark due to impact, friction and installation. Anti-sparking wrenches should be utilized.
3. The temperature sensor should be connected to the power supply or other external circuit using the appropriate cable glands and wire entries.
4. For ambient temperature higher than 158°F , suitable cables, conduit and conductors must be used. Only use approved wire entries.
5. When utilized in dust atmospheres, the connection between the housing, fittings and thermowell should provide a minimum degree of ingress protection. Liquid/gas sealants should be used. Local regulations need to be respected.

Installation Guidelines and Safety Instructions

CAUTION Electrical shock could cause death or serious injury. If the sensor is installed in a high voltage environment and a fault or installation error occurs, high voltage may be present on the connection terminals or the probe itself.


Safe and secure operation of the temperature sensor can only be guaranteed if the operating instructions of the used transmitters and all included safety notes are read, understood and followed. For Endress+Hauser temperature transmitters see enclosed CD-ROM.

Correct use The manufacturer cannot be held responsible for damage caused by misuse of the unit. The installation conditions and connection values indicated in the operating instructions must be followed!

Important Notice

Installation

Installation locations

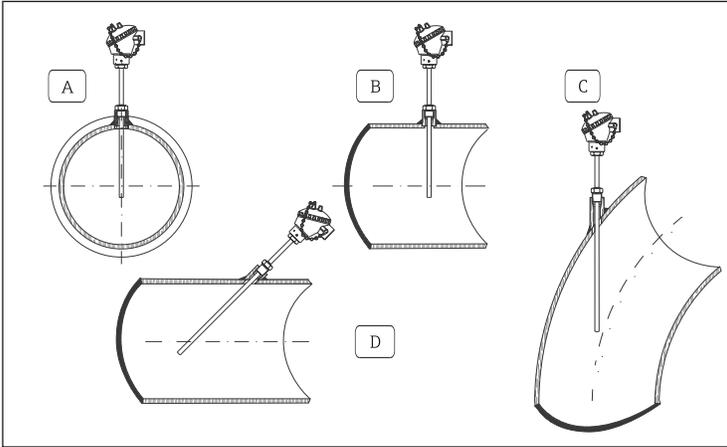


A, B: In pipes of a small section the axis line of the duct must be reached and if possible slightly exceeded by the tip of the probe.
C, D: ilted installation.

For installation proceed as follows:

1. Seal the 1/2" NPT process connection or the pipe thread of the compression fitting with pipe thread sealant, e.g. "TFE" tape before screwing in the device.
2. Make sure that the process fitting matches the maximum specified process pressure.
3. Install and tighten the RTD sensor before applying process pressure.

Dimensions

All dimensions in inches

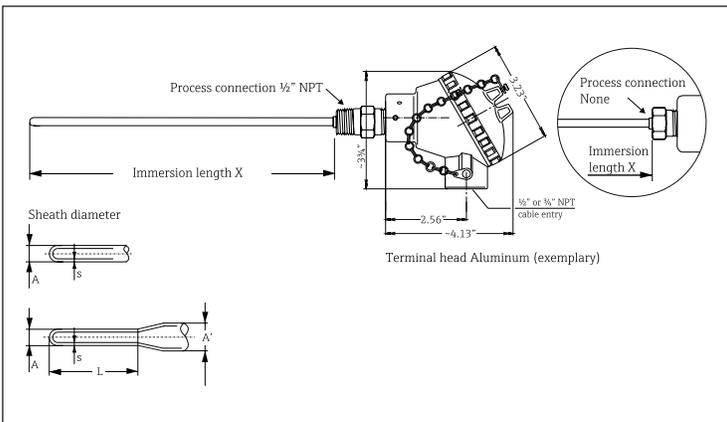


Immersion length X	Sheath diameter A (A')	Wall thickness s	Reduced length L
4", 6", 9", 12" specified length 2" to 96" in 1/2" increments	1/8"	0.012"	-
	3/16"	0.020"	-
	1/4"	0.028"	-
	3/8" (A') red. 3/16" (A)	0.120" (0.016" at tip)*	1 1/4"


*High temperature version is not available with reduced tip

Electrical connection-wiring diagrams

Transmitter mounted (3" or 5 1/2" flying leads - crimped sleeves)

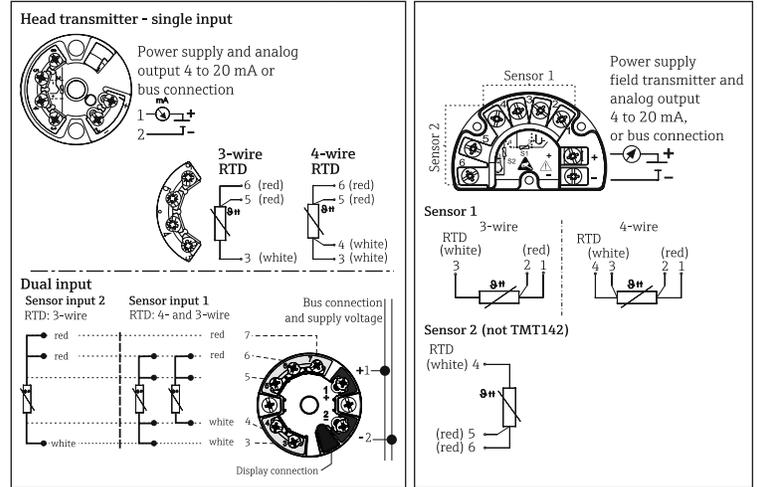

Terminal block mounted (3" flying leads - fork lugs)

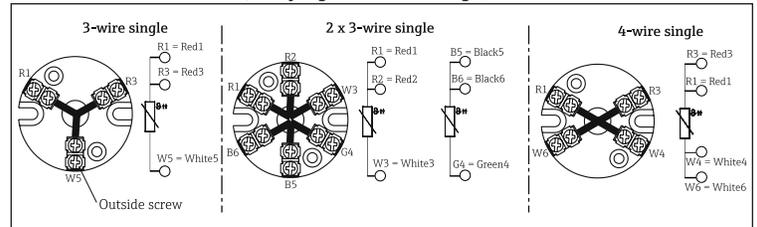

i The blocks and transmitters are shown as they will sit inside the heads in reference to the conduit opening. ALWAYS terminate leads to the outside screw!

Technical data

Weight From 1 to 5.5 lbs
Material Wetted parts 316 SS
Shock and vibration resistance 4g/2 to 150 Hz as per IEC 60 068-2-6
Ambient temperature limits

Housing without head-mounted transmitter	
Aluminium pressure die-cast housing	-40 to 302 °F (-40 to 150 °C)
Plastic housing	-40 to 185 °F (-40 to 85 °C)
Housing with head-mounted transmitter	
All types of housing	-40 to 185 °F (-40 to 85 °C)

Performance Characteristics

Response time 63% response time per ASTM E644

Construction	Ø 1/8"	Ø 3/16"	Ø 1/4"	Ø 3/8" red. 3/16"
High temp. range	2 s	2 s	3 s	not available
Low temp. range	3 s	7 s	9 s	6 s

Maximum measured error

Class	max. Tolerances (°C)
A	± (0.15 + 0.002 · t *)
B	± (0.3 + 0.005 · t *)

* |t| = absolute value °C. For measured error in °F, calculate using equation above in °C, then multiply the outcome by 1.8.

Insulation resistance

Insulation resistance between terminals and probe sheath, test voltage 250 V.
 ■ ≥ 100 MΩ at 77 °F (25 °C)
 ■ ≥ 10 MΩ at 572 °F (300 °C)